



# ILLINOIS ENVIRONMENTAL PROTECTION AGENCY

1021 NORTH GRAND AVENUE EAST, P.O. BOX 19276, SPRINGFIELD, ILLINOIS 62794-9276 • (217) 782-3397

**PAT QUINN**, GOVERNOR

**JOHN J. KIM**, INTERIM DIRECTOR

## **Division of Public Water Supplies (DPWS) Report Drought Response Task Force July, 24, 2012**

The Illinois Environmental Protection Agency (Illinois EPA's) DPWS Marion Region Office highlighted that the Vienna Correctional Center is the only system in their area that has had a steady decrease in levels (that seem to be worsening). These levels are not yet critical; however, the operator has never seen it this low at this time of year.

The Illinois EPA Elgin Region Office again highlighted that many supplies are reporting extremely high water demand and they want the Illinois EPA to reevaluated (or be prepared to reevaluate) their rated plant capacities. Many of these water systems have yet to implement water use restrictions. Prior to re-rating water plant treatment capabilities (which were based upon many factors, not the least of which are filter abilities), these water systems must employ mandatory conservation measures (as Highland Park had to do).

Mt. Pulaski (Logan County) eliminated the sale of bulk water due to declining water levels at the city wells. The water superintendent reported that the pumping level is only five feet above the top of the well screen. This is the lowest level ever observed from these wells. He agreed to email us weekly updates for inclusion in the drought report.

## Attachments

Rockford Region 1										
Facility Name	Facility ID	Intake ID	Source	Status	6/12/12 Condition	6/19/12 Condition	6/26/12 Condition	7/3/2012 Condition	7/10/12 Condition	7/16/2012 condition
IWC Streator	IL0995030	IN00150	Streator Reservoir	A	4ft down from full due to nitrates in river	1 ft below full : 6/21 full reservoir	6/27: reservoir full: 90 day supply		7/11: res full = 90 day supply	res full = 90day supply
IWC Streator	IL0995030	IN11523	Vermilion River	A	3.84ft	3.97ft	3.53ft	3.23ft	2.91 ft	2.86ft
<a href="mailto:David.Clifton@amwater.com">David.Clifton@amwater.com</a>			(at Leonore dam)		24hr change -.03 ft	24hr change -.18ft	24hr change -.09ft	24 hr change - 0.04ft	24hr change - 0.03ft	24hr change +0.04ft
815/672-4557							120cfs flow	68cfs	28cfs	12cfs
			Vermillion				2.89ft	2.72ft	2.47ft	2.57ft
			(at Pontiac dam )				39cfs	22cfs	5cfs	3.03cfs
East Moline	IL1610250	IN31934	Mississippi River	A	18.52 ft	18.21 ft	18.43ft	18.54 ft	18.32ft	18.27
<a href="mailto:LDrake@eastmoline.com">LDrake@eastmoline.com</a>			L&D 15 pool		24hr change +.01ft	24hr change -.31ft	24hr change -.08ft	24 hr change +0.04ft	24 hr change - 0.18ft	24 hr change - 0.09ft
309/752-1519										
Moline	IL1610450	IN31943	Mississippi River	A	18.52 ft	18.21 ft	18.43ft	18.54 ft	18.32ft	18.27
<a href="mailto:gswanson@moline.il.us">gswanson@moline.il.us</a>			L&D 15 pool		24hr change +.01ft	24hr change -	24hr change -	24 hr change	24 hr change -	24 hr change -

						.31ft	.08ft	+0.04ft	0.18ft	0.09ft
309/524-2300										
Rock Island	IL1610650	IN3194 8	Mississippi River	A	18.52 ft	18.21 ft	18.43ft	18.54 ft	18.32ft	18.27
<a href="mailto:cook.larry@rigov.org">cook.larry@rigov.org</a>			L&D 15 pool		24hr change +.01ft	24hr change - .31ft	24hr change - .08ft	24 hr change +0.04ft	24 hr change - 0.18ft	24 hr change - 0.09ft
309/732-2310										
Rock Island Arsenal	IL1615387	IN3194 6	Mississippi River	A	18.52 ft	18.21 ft	18.43ft	18.54 ft	18.32ft	18.27
<a href="mailto:Christian.Hawkinson@us.army.mil">Christian.Hawkinson@us.army.mil</a>			L&D 15 pool		24hr change +.01ft	24hr change - .31ft	24hr change - .08ft	24 hr change +0.04ft	24 hr change - 0.18ft	24 hr change - 0.09ft
309-782- 7400										
<a href="http://www2.mvr.usace.army.mil/WaterControl/stationinfo2.cfm?sid=LNRI2&amp;fid=LNRI2&amp;dt=S">http://www2.mvr.usace.army.mil/WaterControl/stationinfo2.cfm?sid=LNRI2&amp;fid=LNRI2&amp;dt=S</a>						Streator - Leonore dam				
<a href="http://www2.mvr.usace.army.mil/WaterControl/stationinfo2.cfm?sid=PNTI2&amp;fid=PNTI2&amp;dt=S">http://www2.mvr.usace.army.mil/WaterControl/stationinfo2.cfm?sid=PNTI2&amp;fid=PNTI2&amp;dt=S</a>						Streator - Pontiac dam				
<a href="http://www2.mvr.usace.army.mil/WaterControl/stationinfo2.cfm?sid=MI15P&amp;fid=&amp;dt=S">http://www2.mvr.usace.army.mil/WaterControl/stationinfo2.cfm?sid=MI15P&amp;fid=&amp;dt=S</a>						Quad Cities - Mississippi - Pool 15				

# Community & Non-Community Surface Water Supply Intakes PWS Region 1

## COMMUNITY WATER SUPPLY INTAKES

System Name	Sys #	Intake ID
East Moline	1010250	31934
Moline	1010450	31943
Rock Island	1010850	31948
Rock Island Arsenal	1015387	31940
IAWC Streator	0995030	00150
IAWC Streator	0995030	11523

## LEGEND

- Community Water Supply Intakes
- Non-Community Intakes
- Interstates
- State Highways
- US Highways
- Rivers and Streams
- PWS Region 1
- PWS Region 3.1
- County Boundaries



Division of Public Water Supplies  
Groundwater Section  
January, 2011

10 0 10 20 30 40 Miles

## Contacts

### Division of Public Water Supplies:


Rockford Regional Office - 815/987-7760  
Brett Hanson - Regional Manager  
Field Operation Section - Springfield  
217/782-1020  
Dave McMillan - Manager

### Division of Water Pollution Control:

Rockford Region 1 - 815/987-7760  
Chuck Corley - Manager  
Peoria Region 3 - 309/693-5463  
Bruce Yurdin - Manager  
Headquarters - Springfield - 217/782-3362  
Bruce Yurdin - FOG Manager

### Illinois Department of Public Health:

217/762-5830  
Division of Environmental Health  
Ken Runkle - Chief  
Non-Community Public Water System Program  
Eric Portz - Manager

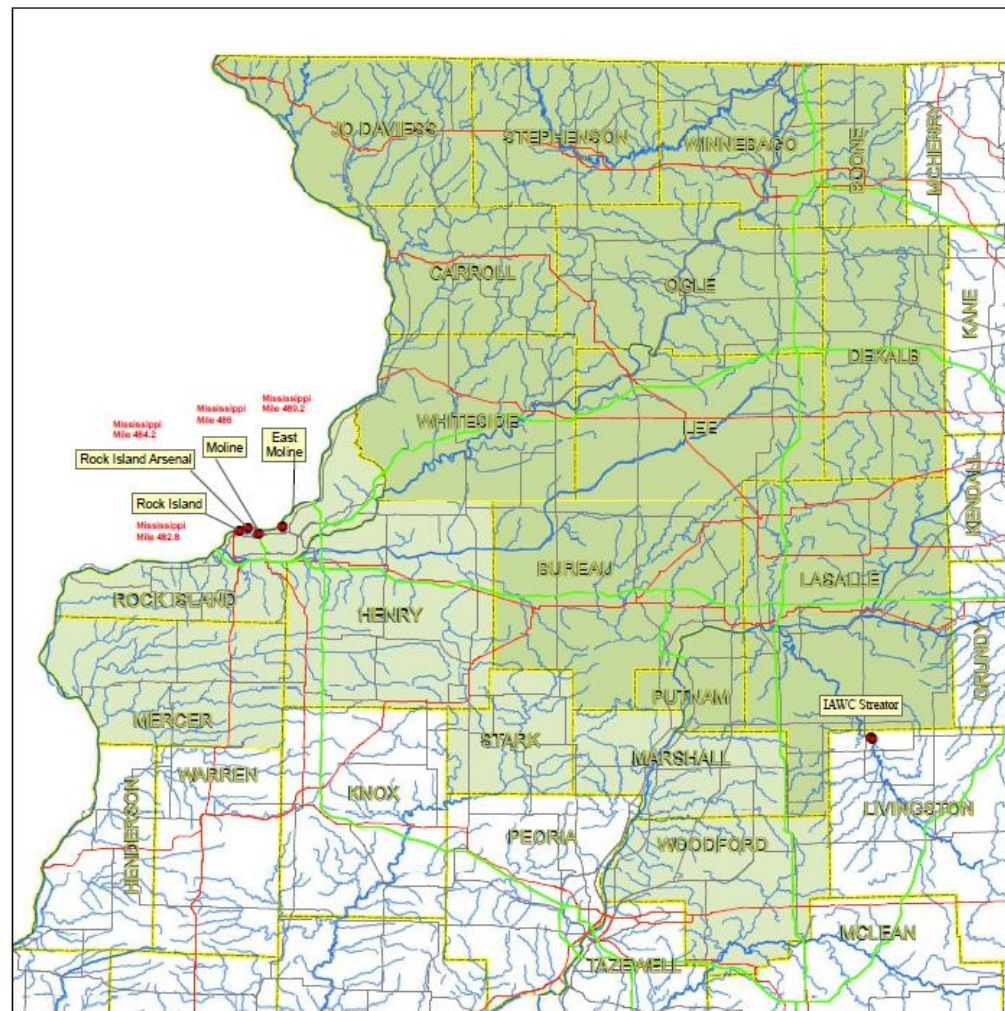

## Region 1 Surface Water System Contacts

System	Sys. #	Name & Certification		Business	Emergency
EAST MOLINE	IL1610250	DRAKE, LEATH	DO	309-752-1520	563-355-6886
EAST MOLINE	IL1610250	LAMBRECHT, DAVID	DO	309-752-1573	
EAST MOLINE	IL1610250	KEEHNER, RICH	AC	309-752-1599	309-752-1520
IL AMERICAN-STREATOR	IL0995030	CLIFTON, DAVID	DO	815-672-2243	815-672-2243
IL AMERICAN-STREATOR	IL0995030	DUNDORE, ESTHER	AC	818-239-3249	800-422-2782
MOLINE	IL1610450	SWANSON, GREGORY	DO	309-797-0489	
MOLINE	IL1610450	WALDRON, MICHAEL P.	AC	309-797-0489	309-797-0489
ROCK ISLAND	IL1610650	COOK, LARRY P.	DO	309-732-2310	309-732-2311
ROCK ISLAND	IL1610650	COOK, LARRY P.	AC	309-732-2310	309-732-2311
ROCK ISLAND ARSENAL	IL1615387	BUTLER, BRYAN	DO	319-263-3434	
ROCK ISLAND ARSENAL	IL1615387	SWYNNENBERG, CHARLES	AC	309-782-2445	309-781-4841

"DO" = Designated Operator

"AC" = Administrative Contact















# Community & Non-Community Surface Water Supply Intakes PWS Region 2

## COMMUNITY WATER SUPPLY INTAKES

System Name	Sys #	Intake ID
Chicago	0316000	00104
Chicago	0316000	00105
Chicago	0316000	01305
Chicago	0316000	01306
Evanston	0310810	21105
Evanston	0310810	01514
Evanston	0310810	01513
Glencoe	0310990	00106
Hammond, IN	9990001	00191
Hammond, IN	9990001	00386
Hammond, IN	9990001	00385
Highland Park	0670500	00110
Highland Park	0670500	01482
Highland Park	0670500	01481
Highwood	0670550	20235
JAWA	0671070	00681
Kenilworth	0311500	00107
Lake County PWD	0675790	00112
Lake Forest	0670800	00111
Lake Forest	0670800	01452
North Chicago	0671250	00113
North Chicago	0671250	01301
North Chicago	0675227	01302
Northbrook	0312070	00130
Northbrook	0312070	01423
Waukegan	0671900	01516
Waukegan	0671900	01517
Wilmette	0313300	01300
Wilmette	0313300	00108
Winnetka	0313330	00109
Winnetka	0313330	01299

## NON COMMUNITY WATER SUPPLY INTAKES

Sys #	System Name
0024976	WILL COUNTY SPORTS CLUB
0016865	SOUTH WILMINGTON FIREARM RANGE
0061869	BRAIDWOOD NUCLEAR POWER

LEGEND	
<span style="color: red;">●</span>	Community Water Supply Intakes
<span style="color: green;">●</span>	Non-Community Intakes
<span style="color: green;">—</span>	Interstates
<span style="color: red;">—</span>	State Highways
<span style="color: blue;">—</span>	US Highways
<span style="color: blue;">—</span>	Rivers and Streams
<span style="color: purple;">—</span>	PWS Region 2
<span style="color: yellow;">—</span>	County Boundaries

## Contacts

### Division of Public Water Supplies:

Elgin Regional Office - 847/608-3131  
 Segundo Nallatan - Regional Manager  
 Field Operation Section - Springfield  
 217/782-1020  
 Dave McMillan - Manager

### Division of Water Pollution Control:



Des Plaines Region 2 - 847/924-4000  
 Jay Patel - Manager  
 Headquarters - Springfield - 217/782-3362  
 Bruce Yurdin - FOS Manager

### Illinois Department of Public Health:

217/782-5830  
 Division of Environmental Health  
 Ken Runkle - Chief  
 Non-Community Public Water System Program  
 Eric Portz - Manager



Division of Public Water Supplies  
 Groundwater Section  
 January, 2011

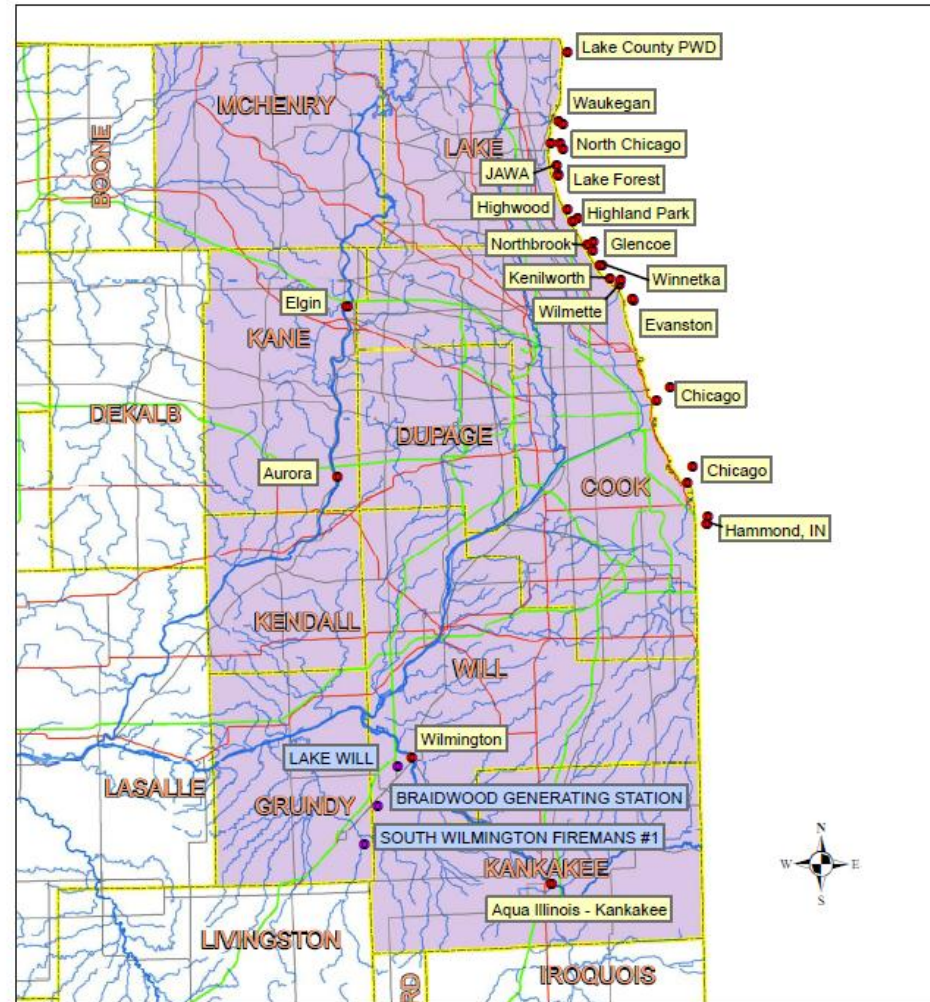

## Region 2 Surface Water System Contacts

System	Sys. #	Name & Certification	Business	Emergency
AQUA ILLINOIS-KANKAKEE	IL0915030	DENAULT, DONALD	DO 815-935-6530	
AQUA ILLINOIS-KANKAKEE	IL0915030	ANTOSZ, DENNIS	DO 815-935-6530	815-935-6530
AQUA ILLINOIS-KANKAKEE	IL0915030	BLANCHETTE, CRAIG	AC 815-935-8800	
AURORA	IL0894070	BOOTH, STEVEN	DO 630-844-3632	630-553-7904
AURORA	IL0894070	SCHUMACHER, DAVID E.	AC 630-844-3632	
CENTRAL LAKE CO. JAWA	IL0971070	KOEPSSEL JR, WILLIAM	DO 847-295-7788	847-746-5459
CENTRAL LAKE CO. JAWA	IL0971070	KOEPSSEL, WILLIAM	AC 847-295-7788	847-582-9222
CHICAGO	IL0316000	SPATZ, JOHN	DO 312-744-3720	312-744-7038
CHICAGO	IL0316000	STARK, ALAN	AC 312-742-0618	773-725-1371
ELGIN	IL0894380	JACOBSEN, KYLA	DO 847-931-6160	847-514-7439
ELGIN	IL0894380	JACOBSEN, KYLA	AC 847-931-6160	847-514-7439
EVANSTON	IL0310810	NELSON, JAMES R.	DO 847-866-2945	
EVANSTON	IL0310810	SEMON, EDWIN J.	DO 847-448-8223	
EVANSTON	IL0310810	HENDERSON, JAY S.	DO 847-236-0599	
EVANSTON	IL0310810	BOBKIEWICZ, WALTER J.	AC 847-866-2936	
GLENCOE	IL0310990	MORAN, MICHAEL	DO 847-835-4111	847-826-6319
GLENCOE	IL0310990	HARLOW, PAUL	AC 847-835-4114	847-835-4112
HIGHLAND PARK	IL0970500	JENSEN, DONALD	DO 847-433-4355	847-433-4355
HIGHLAND PARK	IL0970500	ANDERSON, MARY	AC 847-432-0807	847-433-4355
HIGHWOOD	IL0970550	HARDING, JEFFREY	DO 847-432-3730	847-266-7314
HIGHWOOD	IL0970550	DONOFRIO, VINCENT	AC 847-432-3730	847-432-1924
KENILWORTH	IL0311500	ZEOLI, KEVIN	DO 847-448-8222	
KENILWORTH	IL0311500	BURKE, BRADLY	AC 847-251-1094	847-561-9038
LAKE COUNTY PWD	IL0975790	WHITE, DONALD J.	DO 847-746-2053	847-738-2053
LAKE COUNTY PWD	IL0975790	WHITE, DONALD J.	AC 847-746-2053	847-738-2053
LAKE FOREST	IL0970800	HENSEL, WILLIAM	DO 847-615-4277	847-234-7638
LAKE FOREST	IL0970800	DRAEGER, DAN	DO 847-810-3570	847-234-7638
LAKE FOREST	IL0970800	MAGNUS, KENNETH M.	DO 847-810-3551	847-234-7638
LAKE FOREST	IL0970800	THOMAS, MICHAEL	AC 847-810-3540	847-234-7638
NORTH CHICAGO	IL0971250	ROCKINGHAM JR., LEON	AC 847-596-8610	847-596-8776
NORTH CHICAGO	IL0971250	ROCKINGHAM JR., LEON	AC 847-596-8610	847-596-8776
NORTHBROOK	IL0312070	PAPRECK, THOMAS	DO 847-480-0636	
NORTHBROOK	IL0312070	SCHWARZ, JOHN H.	DO 847-480-0636	
NORTHBROOK	IL0312070	GARDNER, KENNETH	AC 847-509-5335	
WAUKEGAN	IL0971900	MUSINSKI, JEFFERY	DO 847-599-2687	847-599-2687
WAUKEGAN	IL0971900	ADAMAIAK, JULIA	DO 815-599-2687	
WAUKEGAN	IL0971900	TAYLOR, ERNEST	DO 847-599-2687	847-599-2687
WAUKEGAN	IL0971900	MUSINSKI, JEFFERY	AC 847-599-2687	
WILMETTE	IL0313300	QUAFISHEH, NABIL	DO 847-853-7531	
WILMETTE	IL0313300	MAHERHOFER, BRIGITTE	AC	
WILMINGTON	IL1971100	PLESE, JACQUE	DO	
WILMINGTON	IL1971100	GRAFF, TONY	AC 815-476-2175	
WINNETKA	IL0313330	FREELY, PATRICK	DO 847-716-3644	847-501-2531
WINNETKA	IL0313330	CURLEY, BRIAN	AC 847-716-3620	

\*DO\* = Designated Operator

\*AC\* = Administrative Contact



Effingham	IL049025 0	IN0145 9	Little Wabash River	A	river source - no current issue	same	same	same	same	too low to use
Effingham	IL049025 0	IN0146 0	Lake Sara	A	backup - no current issue	same	same	same	same	down 2.5 '
Effingham	IL049025 0	IN4517 0	CIPS Lake	A	side channel - no issue	same	same	same	same	same
										1.5" rain - 7/14
Holland Energy		IN0189 5	Kaskaskia River	A	river source - no current issue	same	same	same	same	same
								20 mgd released from LS		
IAWC Pontiac	IL105503 0	IN0135 6	Pontiac Quarry Reservoir	A	side channel - no current issue	same	same	same	same	same
IAWC Pontiac	IL105503 0	IN4752 1	Vermilion River	A	river source -no current issue	same	same	same	same	same
Mattoon	IL029025 0	IN4511 2	Lake Paradise	A	3" below overflow	4 " below overflow	5" below overflow	7" below overflow	3" below overflow	3" below overflow
Mattoon	IL029025 0	IN4511 3	Lake Mattoon	A	3" below overflow	6 " below overflow	9" below overflow	13.5" below overflow	15 " below overflow	17.5" below overflow
Neoga	IL035015 0	IN4501 9	Lake Mattoon	A	See Mattoon	See Mattoon	See Mattoon	See Mattoon	See Mattoon	See Mattoon
Oakwood	IL183060 0	IN4510 2	Salt Fork	A	river source - no current issue	same	same	same	same	same



Oakwood	IL183060 0	IN4510 3	Reservoir	A	side channel - no current issue	same	same	same	same	same
---------	---------------	-------------	-----------	---	------------------------------------	------	------	------	------	------

# Community & Non-Community Surface Water Supply Intakes PWS Region 4

## COMMUNITY WATER SUPPLY INTAKES

System Name	Sys #	Intake ID
Charleston	0290100	01670
Charleston	0290100	01680
IAWC Pontiac	1055030	01356
IAWC Pontiac	1055030	47521
Bloomington	1130200	47615
Bloomington	1130200	47614
Oakwood	1830600	45102
Oakwood	1830600	45103
Decatur	1150150	45004
Mattoon	0290250	45112
Mattoon	0290250	45113
Neoga	0350150	45019
Altamont	0490050	45018
Effingham	0490250	45170
Aqua Illinois - Vermilion	1835120	47698
Effingham	0490250	01460
Effingham	0490250	01459
EJ Water Co.	0790010	01952
Holland Energy		01895

## NON-COMMUNITY WATER SUPPLY INTAKES

Sys #	System Name
0132183	TRIGE-ENERGY SOLUTIONS
0001420	CAMP ROBERT DRAKE
0014266	FOREST GLEN - POND WATER
0014787	WILDERNESS LAKE CAMPGROUND
0097741	KENNEKUK COVE COUNTY PARK
0108720	VERMILION FISHING CLUB
0117572	POLLYWOGS ASSOCIATION INC
0112201	AMERGEN ENERGY COMPANY

LEGEND	
<span style="color: red;">●</span>	Community Water Supply Intakes
<span style="color: blue;">●</span>	Non-Community Intakes
<span style="color: green;">—</span>	Interstates
<span style="color: red;">—</span>	State Highways
<span style="color: blue;">—</span>	US Highways
<span style="color: blue;">—</span>	Rivers and Streams
<span style="color: red;">—</span>	PWS Region 4
<span style="color: yellow;">—</span>	County Boundaries

## Contacts

**Division of Public Water Supplies:**  
Champaign Regional Office - 217/278-5800  
Steve Johnson  
Field Operation Section - Springfield  
217/782-1020  
Dave McMillan - Manager

**Division of Water Pollution Control:**  
Champaign Region - 217/278-5800  
Joe Koronkowski - Manager  
Headquarters - Springfield - 217/782-3362  
Bruce Yurdin - FOS Manager


**Illinois Department of Public Health:**  
217/782-5830  
Division of Environmental Health  
Ken Runkle - Chief  
Non-Community Public Water System Program  
Eric Portz - Manager



10 0 10 20 30 40 50 Miles



Division of Public Water Supplies  
Groundwater Section  
January, 2011

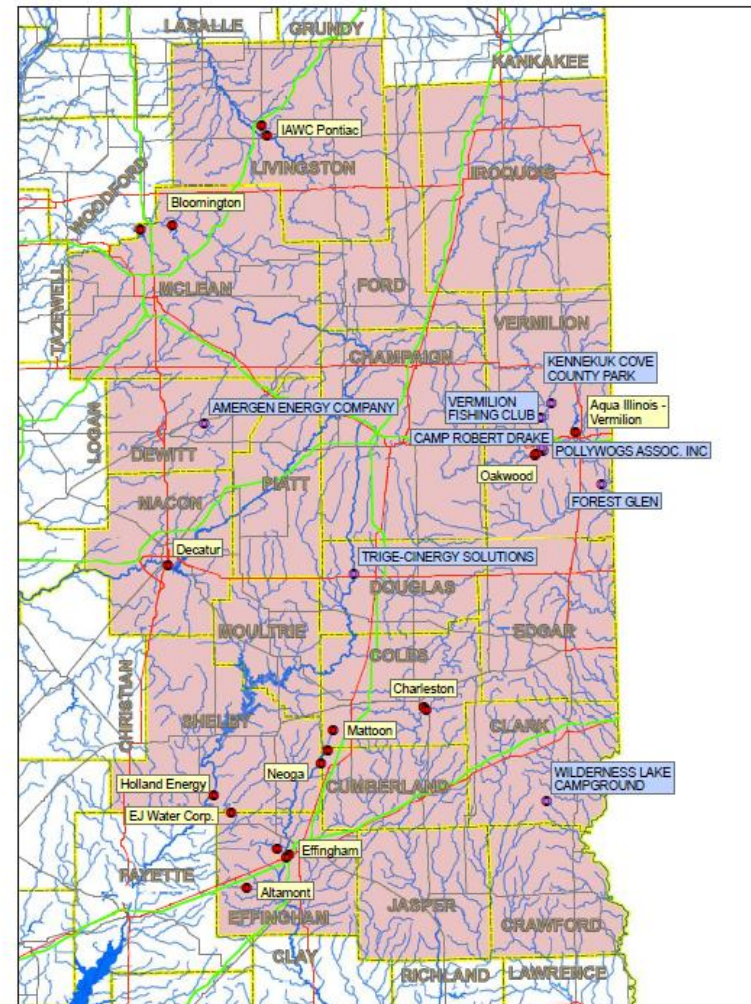

## Region 4 Surface Water System Contacts

System	Sys. #	Name & Certification	Business	Emergency
ALTAMONT	IL0490050	WHITTEN, KEVIN	DO 618-483-6370	618-483-5650
ALTAMONT	IL0490050	WHITE, JR., GERALD	AC 618-483-6370	618-483-5650
AQUA ILLINOIS-VERMILION	IL1835120	CRONK, DAVID	DO 217-442-3063	217-431-4968
AQUA ILLINOIS-VERMILION	IL1835120	GABEHART, JOSHUA C.	DO 214-442-3063	
AQUA ILLINOIS-VERMILION	IL1835120	BRUNS, THOMAS M	AC 217-443-8538	317-339-6179
BLOOMINGTON	IL1130200	LUESCHEN, BRETT	DO	
BLOOMINGTON	IL1130200	TWAIT, RICHARD	DO 309-747-2455	309-467-4542
BLOOMINGTON	IL1130200	CUMMINGS, CRAIG M.	AC 309-434-2225	309-261-3247
CHARLESTON	IL0290100	BOSLER, GEORGE	DO 217-348-1363	217-345-2977
CHARLESTON	IL0290100	BUESCHER, CURT	AC 217-345-8455	217-549-3744
DECATUR	IL1150150	MILLER, RANDY	DO 217-875-5705	
DECATUR	IL1150150	GIGER, DONALD	DO 217-424-2866	217-620-4120
DECATUR	IL1150150	ALEXANDER, KEITH D.	AC 217-424-2863	217-876-7633
EFFINGHAM	IL0490250	ZIEGLER, MICHAEL R.	DO 217-347-5056	217-821-9102
EFFINGHAM	IL0490250	ARNDT, JAMES W.	AC 217-342-5308	217-821-5039
E J WATER CORP	IL0790010	SWINGLER, DEAN	DO 217-925-5566	217-254-5566
E J WATER CORP	IL0790010	TEICHMILLER, BILL	AC 217-925-5566	217-254-5762
IL AMERICAN-PONTIAC	IL1055030	TULEY, TIM	DO 815-844-5418	815-844-5369
IL AMERICAN-PONTIAC	IL1055030	DUNDORE, ESTHER	AC 618-239-3249	800-422-2782
MATTOON	IL0290250	BASHAM, WILLIAM DAVID	DO 217-234-2454	217-235-3239
MATTOON	IL0290250	WORTMAN, DAVID	AC 217-235-5460	
NEOGA	IL0350150	HELM, JR., THOMAS H.	DO 217-895-2172	
NEOGA	IL0350150	MODGLIN, HOWARD	AC 217-895-3237	
OAKWOOD	IL1830600	WENDELL, STEVEN	DO 217-354-2466	217-354-4255
OAKWOOD	IL1830600	WENDELL, STEVEN	AC 217-354-2466	217-354-4255

"DO" = Designated Operator

"AC" = Administrative Contact

Springfield Region 5								
Facility ID	Intake ID	Source	Status	6/19/12 Condition	6/26/12 Condition	7/3/12 Condition	7/11/12 Condition	7/16/12 Condition
IL0170100	IN52035	Ashland Old Reservoir	A	No longer a surface supply. Purchases water from Cass Rural Water District and North Morgan Water Coop	No longer a surface supply. Purchases water from Cass Rural Water District and North Morgan Water Coop	No longer a surface supply. Purchases water from Cass Rural Water District and North Morgan Water Coop	No longer a surface supply. Purchases water from Cass Rural Water District and North Morgan Water Coop	No longer a surface supply. Purchases water from Cass Rural Water District and North Morgan Water Coop
IL1090100	IN00980	Blandinsville NW Res	A	Both reservoirs are full.	Both reservoirs are full.	7/3/12: Both reservoirs near capacity. Pumping from the creek continues	7/9/12: Both reservoirs near capacity. Pumping from the creek continues	Same. Both reservoirs near capacity
IL1090100	IN52077	LaHarpe Creek	A	The north reservoir was filled by pumping from the Creek last week.	The north reservoir was filled by pumping from the Creek last week.			
IL1090100	IN52078	Blandinsville Reservoir	A					

IL057025 0	IN0137 4	Canton Lake	A	down 60 inches.	down 60 inches.	7/3/12: using the new ranney well exclusively. Lake is down 74- inches	7/9/12: using the new ranney well exclusively. Lake is down 80- inches	using the new ranney well exclusively. Lake is down 83-inches
IL057025 0	IN5808 9	Canton Lake	A	ordinances required conservation efforts at 12 ft. below full pool. Now have ranney well also.	ordinances required conservation efforts at 12 ft. below full pool. Now have ranney well also.			
IL117015 0	IN5808 8	Lake Carlinville	A	no issues - down 3 inches	no issues - down 3 inches	7/3/12: Down 10- inches	7/3/12: Down 10- inches	both lakes down approximately 12 inches
IL067025 0	IN5213 3	Carthage Reservoir	A	no issues - down 30 inches	no issues - down 30 inches	3' low - no conservation measures/no t until 6-7' low	3' low - no conservation measures/no t until 6-7' low	4'-9" low - no conservation measures/not until 6-7' low
IL117040 0	IN5213 0	New Gillespie Lake	A	no issues- down 6 inches	no issues- down 6 inches	7/3/12: Down 12- inches	7/9/12: Down 18- inches	Down 20 inches. No immediate concerns
IL067040 0	IN0034 2	Mississippi River	A	River source – no current issue	River source – no current issue	River source – no current issue	River source – no current issue	River source – no current issue

IL067040 0	IN5212 8	Mississippi River	A	River source – no current issue	River source – no current issue	River source – no current issue	River source – no current issue	
IL135030 0	IN5212 5	Lake Hillsboro	A	no issues	no issues	7/3/12: Down 20- inches, Deer Run Mine use of the lake becomes limited	7/9/12: Down 32- inches, Deer Run Mine use of the lake becomes prohibited, voluntary conservation enacted	Lake down 35 inches. Voluntary conservation measures activated. Deer Run Mines use of the lake terminated
IL135030 0	IN5212 6	Lake Glenn Shoals	A	no issue- down 9 inches	no issue- down 9 inches			
IL143503 0	IN5215 9	Illinois River	A	River source – no current issue	River source – no current issue			
IL137020 0	IN5212 3	Mauvaise Terre Lake	A	No current issue	No current issue	no conservation measures in place. 6" low. Using 25% lakes and 75% wells.	no conservation measures in place. 6" low. Using 25% lakes and 75% wells.	no conservation measures in place. 13" low. Using 25% lakes and 75% wells.
IL137020 0	IN5212 4	Lake Jacksonville	A	No current issue	No current issue	11" low	11" low	19" low. Gate opened to flow to Mauvaise Terre Lake.

IL067045 0	IN5800 3	LaHarpe Reservoir	A	no issues - down 6 inches	no issues - down 6 inches	16" low - no conservation measures	16" low - no conservation measures	20" low (est.) - no conservation measures
IL067045 0	IN5800 4	S Branch Crooked Creek	A					
IL135040 0	IN0024 8	Litchfield Lake	A	near capacity	near capacity	7/3/12: Down 1 ft.	7/9/12: Down 1 ft.	
IL135040 0	IN5803 4	Lake Lou Yaeger	A	only down apprx. 4 inches	only down apprx. 4 inches			Lake down appoximately 10 inches
IL109035 0	IN5805 5	Spring Lake	A	no issues- down 2 inches	no issues- down 2 inches		no issues - down 4 inches	no issues - down 6 inches
IL109035 0	IN5805 8	E Fork LaMoine River	A	RO/well used more since WIU is out for the summer to conserve lake water	RO/well used more since WIU is out for the summer to conserve lake water			Pumping from WL58057 to the lake. Rehabilitating WL58056 to do the same.
IL117070 0	IN5211 5	Old Mount Olive Reservo	A					
IL117070 0	IN5211 6	Mount Olive Lake	A	no issues - down 10 inches	no issues - down 10 inches	7/3/12: Down 17 inches. Concerns at levels down to 3.5 ft.	7/9/12: Down 21 inches. Concerns at levels down to 3.5 ft.	Down 24 inches. Voluntary restrictions have been implemented
IL067050 0	IN5210 2	Mississippi River	A	River source – no current issue	River source – no current issue	River source – no current issue	River source – no current issue	River source – no current issue

IL167080 0	IN5210 3	Spring Creek	A	No longer a surface supply. Purchases water from South Sangamon Water Commission	No longer a surface supply. Purchases water from South Sangamon Water Commission	No longer a surface supply. Purchases water from South Sangamon Water Commission	No longer a surface supply. Purchases water from South Sangamon Water Commission	No longer a surface supply. Purchases water from South Sangamon Water Commission.
IL167080 0	IN5210 4	New Berlin Reservoir	A					
IL117520 0	IN5805 9	Otter Lake	A	no issues - down 6 inches	no issues - down 6 inches	7/3/12: Down 18 inches	7/9/12: Down 22 inches	Lake remains down 22 inches
IL117515 0	IN5211 7	Palmyra-Modesto Lake	A	no issues - down 8 inches	no issues - down 8 inches	7/3/12: Down 8 inches	7/9/12: Down 10 inches	Down 12 inches
IL021050 0	IN5210 0	Lake Pana	A	No current issue	No current issue	13" low - no conservation measures	13" low - no conservation measures	18" low - no conservation measures



IL001065 0	IN0157 5	Mississippi River	A	River source – no current issue	River source – no current issue	River source – no current issue	River source – no current issue	<p>The current Mississippi River gauge that we use registers 11.56'. The lowest level that our records show was a 10.8' level on October 2, 2003. No conservation methods are currently being imposed. However the demand conditions of our water supply are being monitored on a daily basis. Should the total daily water demand equal or exceed 75% of the current available system operating capacity for three consecutive days or if total daily demand equals or exceeds 80% of the current available system operating capacity on a single day then the City would request that all nonessential water use be restricted. However our current maximum daily consumption averages for May/June 2012 equal only 8.956MGD (max flow is 14.5 mgd) and we are not there yet.</p>
IL001065 0	IN5209 9	Mississippi River	A	River source – no current issue	River source – no current issue	River source – no current issue	River source – no current issue	

IL167120 0	IN5214 0	Lake Springfield	A	No current issue	No current issue - Current level as of 6/22/12 is 559.67', full pool is 600.00'	full pool = 560'. lake at 559.24'. Voluntary conservation measures being promoted. Pumping from south fork 2-3 times per week.	full pool = 560'. lake at 559.24'. Voluntary conservation measures being promoted. Pumping from south fork 2-3 times per week.	full pool = 560'. lake at 558.50'. Voluntary conservation measures being promoted. Pumping from south fork 2-3 times per week when can.
IL167120 0	IN5214 1	Horse Creek	A	No current issue	No current issue			
IL117105 0	IN5209 7	Staunton Reservoir	A	No current issue-near capacity	No current issue-near capacity	7/3/12: Down 1 ft. Conservatio n measures at 3 ft.	7/9/12: Down 16 inches. Conservatio n measures at 3 ft.	Down 20 inches.
IL021060 0	IN5208 9	Lake Taylorville	A	No current issue	No current issue	no conservation measures in place. Lake down 6". 25% lake and 75% well use.	no conservation measures in place. Lake down 6". 25% lake and 75% well use.	no conservation measures in place. Full pool at 590.00'. Currently at 589.2'. 25% lake and 75% well use.
IL057095 0	IN5208 1	Vermont Reservoir	A	no current issues -	no current issues -	7/3/12: Down 11	7/9/12: Down 13	Down 14 inches.

				down 6 inches	down 6 inches	inches	inches	
IL067065 0	IN5207 9	Mississippi River	A	River source – no current issue	River source – no current issue	River source – no current issue	River source – no current issue	River source – no current issue
IL137045 0	IN5208 0	Waverly Lake	A	No current issue	No current issue	no conservation measures in place. Lake 4" low.	no conservation measures in place. Lake 4" low.	no conservation measures in place. Lake 9" low.

# Community & Non-Community Surface Water Supply Intakes - PWS Region 5

## COMMUNITY WATER SUPPLY INTAKES

System Name	Sys #	Intake ID
Ashland	0170100	52036
Ashland	0170100	52035
Blandinsville	1090100	52077
Blandinsville	1090100	00980
Blandinsville	1090100	52078
Canton	0570250	01374
Canton	0570250	58089
Carlinville	1170150	58088
Carthage	0670250	52133
Gillespie	1170400	52129
Gillespie	1170400	52130
Hamilton	0670400	52128
Hamilton	0670400	00342
Hillsboro	1350300	52126
Hillsboro	1350300	52125
IAWC Peoria	1435030	52159
Jacksonville	1370200	52123
Jacksonville	1370200	52124
La Harpe	0670450	58003
La Harpe	0670450	58004
Litchfield	1350400	58034
Litchfield	1350400	00248
Macomb	1090350	58058
Macomb	1090350	58055
Mount Olive	1170700	52116
Mount Olive	1170700	52115
Nauvoo	0670500	52102
New Berlin	1670800	52103
New Berlin	1670800	52104
Otter Lake Wtr. Comsn.	1175200	58059
Palmyra-Modesto Wtr. Comsn.	1175150	52117
Pittsfield	1490750	52098
Quincy	0010650	52099
Quincy	0010650	01575
Springfield	1671200	52140
Springfield	1671200	52141
Stanton	1171050	52097
Taylorville	0210600	52089
Vermont	0570950	52081
Warsaw	0670650	52079
Waverly	1370450	52080



## LEGEND

- Community Water Supply Intakes
- Non-Community Intakes
- Interstates
- State Highways
- US Highways
- Rivers and Streams
- PWS Region 5
- County Boundaries

## Contacts

### Division of Public Water Supplies:

Springfield Regional Office - 217/786-6892  
David Cook - Regional Manager  
Field Operation Section - Springfield  
217/782-1020  
Dave McMillan - Manager

### Division of Water Pollution Control:



Peoria Region 3 - 309/693-5463  
Bruce Yurdin - Manager  
Springfield Region 5 - 217/786-6892  
Bruce Yurdin - Manager  
Headquarters - Springfield - 217/782-3362  
Bruce Yurdin - FOG Manager

### Illinois Department of Public Health:

217/782-5830  
Division of Environmental Health  
Ken Runkle - Chief  
Non-Community Public Water System Program  
Eric Portz - Manager

## NON-COMMUNITY INTAKES

Sys #	System Name
0003673	DEER PARK CAMPGROUND
0003236	WESTERN IL 4-H CAMP
0093062	KINCAID GENERATION LLC
0003848	FREEMAN UNITED COAL CO CROWN 2
0113423	CATERPILLAR INC/UTIL ENG SUPT

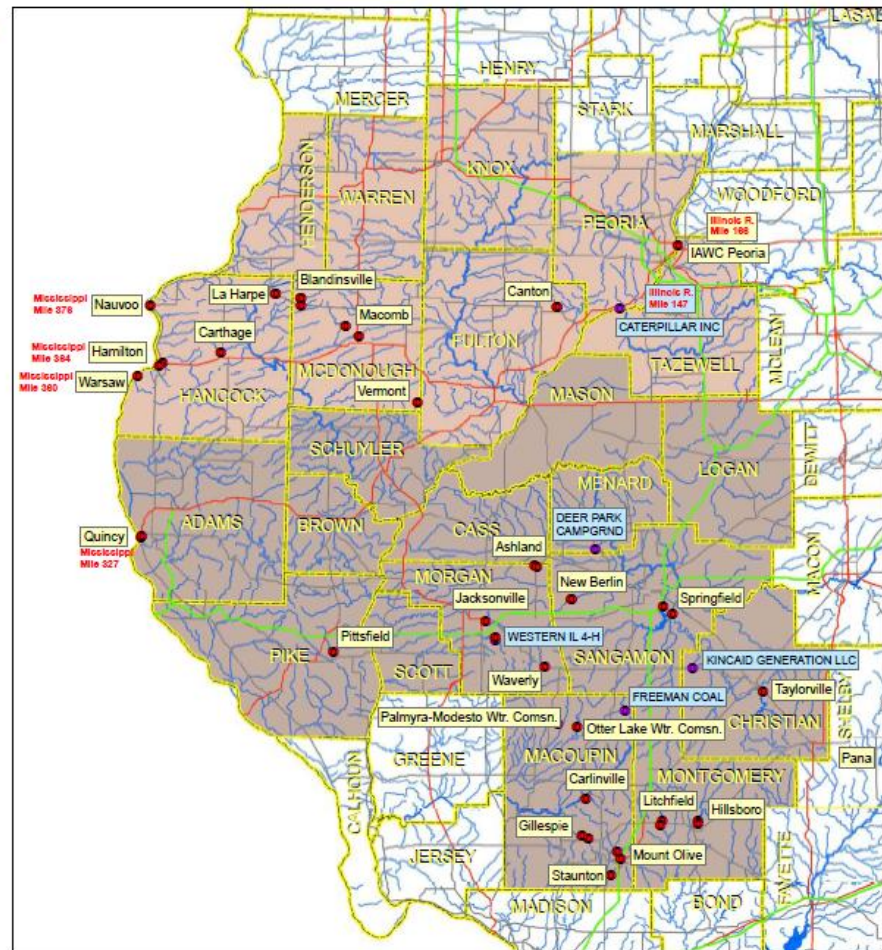

Division of Public Water Supplies  
Groundwater Section  
January, 2011

## Region 5 Surface Water System Contacts

System	Sys. #	Name & Certification	Business	Emergency
ASHLAND	IL0170100	VOTSMIER, HENRY	DO 217-476-8889	
ASHLAND	IL0170100	HANDY, DAVE	AC 217-462-7878	217-899-8193
BLANDINSVILLE	IL1090100	DE HAVEN, DENNIS	DO 309-852-3223	309-852-3846
BLANDINSVILLE	IL1090100	MOORE, MARILYN	AC 309-852-3223	309-852-3846
CANTON	IL0570250	POLLITT, GREGORY	DO 309-847-0080	
CANTON	IL0570250	POLLITT, GREGORY	DO 309-847-0080	
CARLINVILLE	IL1170150	SHAW, PAUL	DO 217-854-8222	
CARLINVILLE	IL1170150	SCHWAB, ROBERT	AC 217-854-5239	217-854-8222
CARTHAGE	IL0670250	CLASSEN, CHRISTOPHER	DO 217-357-2453	217-357-2398
CARTHAGE	IL0670250	NIGHTINGALE, JAMES	AC 217-357-3119	217-357-2398
GILLESPIE	IL1170400	SHUEY, DONALD	DO 217-839-3279	217-839-2922
GILLESPIE	IL1170400	HICKS, JOHN	AC	
HAMILTON	IL0670400	SCHILSON, TIMOTHY	DO 217-847-3774	309-341-8520
HAMILTON	IL0670400	SCHILSON, TIMOTHY	AC 217-847-3774	309-341-8520
HILLSBORO	IL1350300	FATH, ROGER	DO 217-532-2163	217-532-8787
HILLSBORO	IL1350300	MCCAMMACK, DENNIS	AC 217-532-2163	217-532-9402
IL AMERICAN-PEORIA	IL1435030	HORSTMAN, LORI	DO 309-885-4859	800-422-2782
IL AMERICAN-PEORIA	IL1435030	TENNIS, DOUGLAS	DO 309-389-4252	
IL AMERICAN-PEORIA	IL1435030	DUNDORE, ESTHER	AC 618-239-3249	800-422-2782
JACKSONVILLE	IL1370200	COSNER, JOHN (JACK)	DO 217-479-4680	217-245-0979
JACKSONVILLE	IL1370200	COSNER, JOHN (JACK)	DO 217-479-4680	217-245-0979
LA HARPE	IL0670450	GRAVES, TIMMOTHY	DO 217-859-7750	217-859-3951
LA HARPE	IL0670450	GRAVES, TIMMOTHY	AC 217-859-7750	217-859-3951
LITCHFIELD	IL1350400	WELLER, RAYMOND	DO 217-324-2250	217-324-2250
LITCHFIELD	IL1350400	WELLER, RAYMOND	AC 217-324-2250	217-324-2250
MACOMB	IL1060350	COX, RICHARD K.	DO 309-318-0388	
MACOMB	IL1060350	BURNETT, WALTER	AC 309-833-2821	
MOUNT OLIVE	IL1170700	LEONHARDT, ROBERT	DO 217-999-2851	217-999-7535
MOUNT OLIVE	IL1170700	LEONHARDT, ROBERT J.	AC 217-999-2851	217-999-8041
NAUVOO	IL0670500	CUTHBERT, BARRY	DO 217-453-2786	
NAUVOO	IL0670500	MCCARTY, JOHN	AC 217-453-2411	
NEW BERLIN	IL1670800	BLISS, TIMOTHY	DO 217-488-6214	217-306-5908
NEW BERLIN	IL1670800	FRANK, STEPHEN	AC 217-488-6312	217-306-5908
OTTER LAKE WATER CMSN	IL1175200	DILL, ROBERT	DO 217-965-1566	217-899-3199
OTTER LAKE WATER CMSN	IL1175200	ROSS, DENNIS	AC 217-965-1566	217-971-7461
PALMYRA-MODESTO WATER COMMISSION	IL1175150	GARST, LARRY	DO 217-436-2519	217-971-7805
PALMYRA-MODESTO WATER COMMISSION	IL1175150	LAUNER, JAMES	AC 217-439-7453	217-971-4753

System	Sys. #	Name & Certification	Business	Emergency
PANA	IL0210500	BUERK, DONALD	DO 217-562-2741	217-823-1848
PANA	IL0210500	SIPES, STEVEN	AC 217-562-2323	217-562-7105
PITTSFIELD	IL1490750	LEAHR, TERRY	DO 217-285-2031	217-285-5918
PITTSFIELD	IL1490750	HAYDEN, JOHN	AC 217-285-2308	217-285-8944
QUINCY	IL0010650	KENT, DAVID	DO 217-228-4591	217-224-0122
QUINCY	IL0010650	KENT, DAVID	AC 217-228-4591	217-224-0122
SPRINGFIELD	IL1671200	MECKES, TED	DO 217-757-8630	217-789-2116
SPRINGFIELD	IL1671200	STEWART, STEVEN	DO 217-757-8630	217-789-2116
SPRINGFIELD	IL1671200	SKELLY, TOM	AC 217-789-2116	217-652-7495
STAUNTON	IL1171050	FEY, HENRY	DO 618-635-2557	618-635-2824
STAUNTON	IL1171050	WILLMON, JOHN T.	AC 618-635-2233	
TAYLORVILLE	IL0210600	SPEAGLE, DAVID	DO 217-287-1441	217-824-8724
TAYLORVILLE	IL0210600	SPEAGLE, DAVID	AC 217-287-1441	217-824-8724
VERMONT	IL0570950	SMITH, TERRY	DO 309-784-5242	
VERMONT	IL0570950	YOUNG JR, ROBERT	AC 309-221-7730	
WARSAW	IL0670650	HUSTON, GARY	DO 217-430-0845	
WARSAW	IL0670650	SAMUELS, JOSEPH	DO 217-256-4512	217-256-4512
WARSAW	IL0670650	SAMUELS, JOSEPH	AC 217-256-4512	217-256-4512
WAVERLY	IL1370450	SMITH, ANDY	DO 217-435-4111	217-435-9619
WAVERLY	IL1370450	EDWARDS, STEPHEN C.	DO 217-435-4111	217-435-5300
WAVERLY	IL1370450	BOSTIC, JOSEPH G.	AC 217-435-4611	

"DO" = Designated Operator

"AC" = Administrative Contact



Farina	IL051015 0	IN0129 1	Loy Borrow Pit	A	No Current Issue	No Current Issue	No Current Issue	No Current Issue	No Current Issue	No Current Issue
Farina	IL051015 0	IN6006 9	E Fork Kaskaskia River	A	No Current Issue	No Current Issue	No Current Issue	No Current Issue	No Current Issue	No Current Issue
Farina	IL051015 0	IN6007 0	borrow pit	A	No Current Issue	No Current Issue	No Current Issue	No Current Issue	Installed transfer pump to transfer water to main reservoir if necessary.	No change.
Gateway Regional Water Co.	IL027004 0	IN0185 1	Carlyle Lake	A	No Current Issue	No Current Issue	No Current Issue	No Current Issue	No Current Issue	No Current Issue
Greenfield	IL061015 0	IN6009 5	Greenfield Lake	A	No Current Issue	No Current Issue	No Current Issue	No Current Issue	No Current Issue	No Current Issue
Greenville	IL005005 0	IN6009 6	Governor Bond Lake	A	No Current Issue	No Current Issue	No Current Issue	No Current Issue	No Current Issue	No Current Issue
Highland	IL119055 0	IN6010 7	Highland Silver Lake	A	No Current Issue	No Current Issue	No Current Issue	No Current Issue	No Current Issue	No Current Issue
Holiday Shores Sanitary Dist.	IL119511 0	IN6012 6	Holiday Lake	A	No Current	No Current	No Current	No Current	No Current	No Current







# Community & Non-Community Surface Water Supply Intakes - PWS Region 6

## COMMUNITY WATER SUPPLY INTAKES

System Name	Sys #	Intake ID
Breese	0270250	60025
Breese	0270250	00877
Carlyle	0270300	60043
Centralia	1214220	01293
Centralia	1214220	60047
Centralia	1214220	60048
Centralia	1214220	1951
Chester	1570100	60049
Coulterville	1570150	60056
Evansville	1570250	60068
Farina	0510150	60069
Farina	0510150	60070
Farina	0510150	01291
Gateway Regional Water Co.	0270040	01851
Greenfield	0610150	60095
Greenville	0060050	60096
Highland	1190550	60107
Holiday Shores Sanitary Dist.	1195110	60126
IAWC Alton	1195150	01412
IAWC East St. Louis	1635040	60237
IAWC Granite City	1195030	60236
Kaskaskia Water Dist	1635110	60184
Kinmundy	1210300	01290
Kinmundy	1210300	60120
Nashville	1890300	60137
Nashville	1890300	60138
Nashville	1890300	01367
Salem	1210450	60173
Salem	1210450	60174
SLM Wtr. Comsn.	1635090	60023
SLM Wtr. Comsn.	1635090	60024
Sparta	1570600	60183
Sparta	1570600	60181
Sparta	1570600	00702
Vandalia	0510350	60223
Vandalia	0510350	60222



## LEGEND

- Community Water Supply Intakes
- Non-Community Intakes
- Interstate
- State Highways
- US Highways
- Rivers and Streams
- PWS Region 6
- County Boundaries

## Contacts

**Division of Public Water Supplies:**  
 Collinsville Regional Office - 618/346-5120  
 Gayle Battas - Regional Manager  
 Field Operation Section - Springfield  
 217/782-1020  
 Dave McMillan - Manager

**Division of Water Pollution Control:**  
 Springfield Region 5 - 217/786-6892  
 Bruce Yurdin - Manager  
 Collinsville Region 6 - 618/346-5120  
 Joseph Mahandt - Manager  
 Headquarters - Springfield - 217/782-3362  
 Bruce Yurdin - FOS Manager



**Illinois Department of Public Health:**  
 217/782-5830  
 Division of Environmental Health  
 Ken Runkle - Chief  
 Non-Community Public Water System Program  
 Eric Portz - Manager

## NON-COMMUNITY WATER SUPPLY INTAKES

Sys #	System Name
0002170	CEDARBROOK CAMPGROUNDS
0001651	CAMP CHAN YA-TA
0095893	OLIN CORPORATION



Division of Public Water Supplies  
 Groundwater Section  
 January, 2011

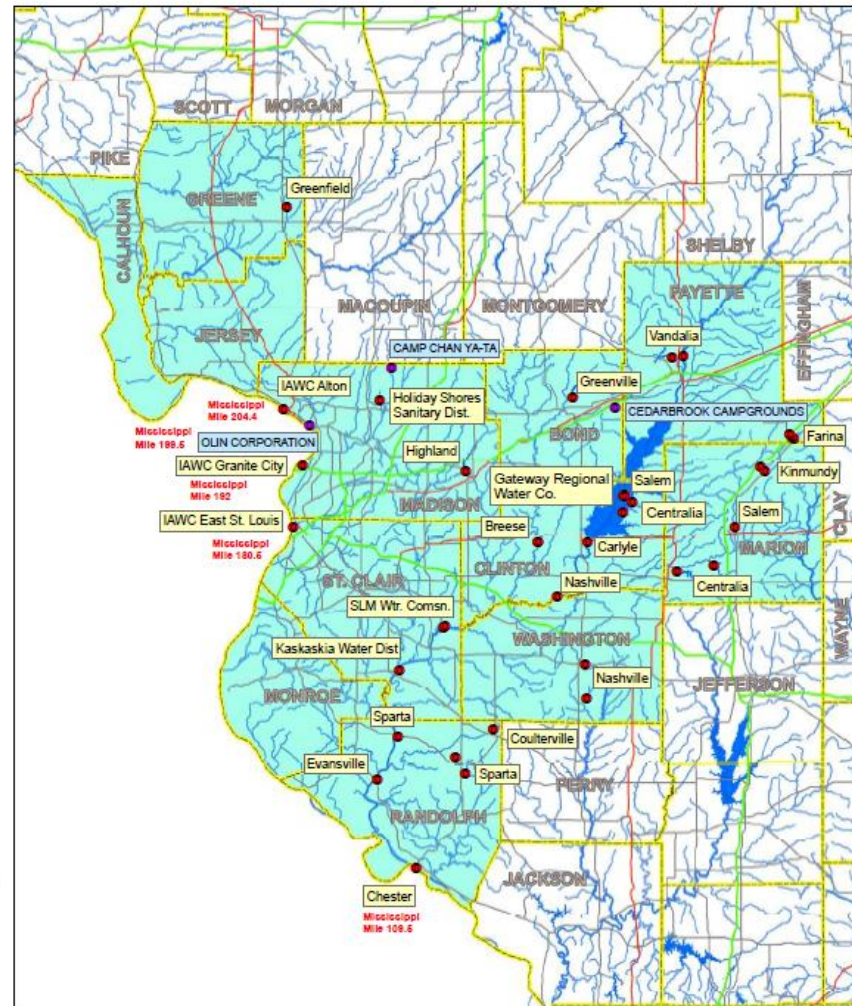

## Region 6 Surface Water System Contacts

System	Sys. #	Name & Certification	Business	Emergency
BREESE	IL0270250	HUELSKAMP, GERALD	DO 618-526-7151	
BREESE	IL0270250	HILMES, CHARLES E.	AC 618-526-7731	
CARLYLE	IL0270300	LAPPE, STEVEN	DO 618-594-3321	
CARLYLE	IL0270300	JONES, GEOFFREY	DO 618-594-3321	
CARLYLE	IL0270300	FAUKE, JAN	AC	
CENTRALIA	IL1214220	JENNINGS, JAMES P.	DO 618-532-7640	618-335-4809
CENTRALIA	IL1214220	WHITE, PERRY A.	DO 618-533-7881	618-918-1117
CENTRALIA	IL1214220	WHITE, PERRY A.	AC 618-533-7881	618-918-1117
CHESTER	IL1570100	EGGEMEYER, MITCH	DO 618-826-3315	618-826-5454
CHESTER	IL1570100	HARTENBERGER, DENNIS	DO 618-826-3315	618-826-5454
CHESTER	IL1570100	EGGEMEYER, MITCH	AC 618-826-3315	618-615-1342
COULTERVILLE	IL1570150	AITKEN, JAMES	DO 618-327-4902	618-758-2168
COULTERVILLE	IL1570150	RUST, ROBERT S.	AC 618-525-9182	
EVANSVILLE	IL1570250	BRAUN, JAMES	DO 618-853-2613	
EVANSVILLE	IL1570250	KUEKER, CINDY	AC 618-853-2613	618-708-0207
FARINA	IL0510150	ROBERTS, JOHN	DO 618-245-6660	618-245-6457
FARINA	IL0510150	ROBERTS, JOHN	AC 618-245-6660	618-245-6457
GATEWAY REGIONAL WATER CO	IL0270040	HENDRICK, JACK D.	DO 618-775-1004	
GATEWAY REGIONAL WATER CO	IL0270040	HENDRICK, JACK D.	AC 618-775-1004	
GREENFIELD	IL0810150	ARMOLD, JAMES	DO 217-368-2137	217-368-2870
GREENFIELD	IL0810150	MORROW, CHARLES L.	AC 217-368-2332	
GREENVILLE	IL0050050	LEIDNER, JEFF	DO 618-664-4779	618-664-4779
GREENVILLE	IL0050050	LEIDNER, JEFF	AC 618-664-0131	618-664-1644
HIGHLAND	IL1190550	BUSS, MIKEL H.	DO 618-654-9321	618-443-8869
HIGHLAND	IL1190550	GILLESPIE, JOSEPH	AC 618-654-7511	618-972-3790
HOLIDAY SHORES SD	IL1195110	DULLE, KENNETH	DO 618-656-1091	
HOLIDAY SHORES SD	IL1195110	KINDER, DONNA	AC 618-656-4933	618-558-8029
IL AMERICAN-ALTON	IL1195150	QUINONEZ, SCOTT	DO 618-465-8736	
IL AMERICAN-ALTON	IL1195150	DUNDORE, ESTHER	DO 618-239-3249	800-422-2782
IL AMERICAN-ALTON	IL1195150	DUNDORE, ESTHER	AC 618-239-3249	800-422-2782
IL AMERICAN-EAST ST LOUIS	IL1635040	LOWRY, DWAYNE E.	DO 618-874-2406	
IL AMERICAN-EAST ST LOUIS	IL1635040	SCOTT, STANLEY L.	DO 618-239-3254	
IL AMERICAN-EAST ST LOUIS	IL1635040	BOYD, SARAH	DO 618-874-2408	800-422-2782
IL AMERICAN-EAST ST LOUIS	IL1635040	DUNDORE, ESTHER	AC 618-239-3249	800-422-2782
IL AMERICAN-GRANITE CITY	IL1195030	LOWRY, DWAYNE E.	DO 618-874-2406	
IL AMERICAN-GRANITE CITY	IL1195030	SCOTT, STANLEY L.	DO 618-239-3254	
IL AMERICAN-GRANITE CITY	IL1195030	BOYD, SARAH	DO 618-874-2408	800-422-2782
IL AMERICAN-GRANITE CITY	IL1195030	DUNDORE, ESTHER	AC 618-239-3249	800-422-2782
KASKASKIA WATER DISTRICT	IL1635110	GILLETTE, GREGORY	DO 618-475-2626	618-758-2812
KASKASKIA WATER DISTRICT	IL1635110	BIAMA, ROBERT	DO 618-475-2626	618-758-2812
KASKASKIA WATER DISTRICT	IL1635110	QUICK, WILLIAM	AC 618-475-2626	618-973-4046
KINMUNDY	IL1210300	CRAIG, JERRY	DO 618-547-7241	618-547-8396
KINMUNDY	IL1210300	CRAIG, JERRY D.	AC 618-547-7241	618-322-8396
NASHVILLE	IL1890300	MIDDLETON, BLAINE	DO 618-327-3428	618-327-3228
NASHVILLE	IL1890300	KOLWEIER, RAYMOND	AC 618-327-3428	618-327-3228
S L M WATER COMMISSION	IL1635090	FELDT, RANDY	DO 618-566-7100	
S L M WATER COMMISSION	IL1635090	MUELLER, DON	AC 618-566-7100	618-566-7100

System	Sys. #	Name & Certification	Business	Emergency
SALEM	IL1210450	WEBER, JASON E.	DO 618-548-7788	
SALEM	IL1210450	CASNER, HERBERT M.	DO 618-548-2222	618-367-0532
SALEM	IL1210450	PRUDEN, JOHN W.	AC 618-548-2222	618-548-2232
SPARTA	IL1570800	ADAMS, BRIAN	DO 618-443-2917	618-443-8884
SPARTA	IL1570800	RHEINECKER, COREY	AC 618-443-2917	618-304-6140
VANDALIA	IL0510350	HUSKEY, MARTIN	DO 618-283-1700	
VANDALIA	IL0510350	HUSKEY, MARTIN	AC 618-283-1700	

\*DO\* = Designated Operator  
 \*AC\* = Administrative Contact

Marion Region 7										
Facility Name	Facility ID	Intake ID	Source	Status	6/12/12 Condition	6/19/12 Condition	6/25/12 Condition	07/02/12 Condition	07/09/12 Condition	07/16/12 Condition
Alto Pass Wtr. Dist	IL1815150	IN71330	Little Cedar Lake	A	Main Source - No concerns	Unchanged	Unchanged	No report	Down 3"	Unchanged
Alto Pass Wtr. Dist	IL1815150	IN71331	Alto Pass Reservoir	A	Inactive - Emergency Only	N/A	N/A	N/A	Supplementing down 6"	Supplementing-down 1'
Carbondale	IL0770150	IN70550	Cedar Lake	A	Main Source O/F @432 - No Concerns	Level 431.4	Level 431.3	Level 431.0	Level 431.0	Level 431.0
Carbondale	IL0770150	IN70551	Carbondale Reservoir	A	Emergency Only	N/A	N/A	N/A	N/A	N/A
Fairfield	IL1910100	IN01369	Little Wabash River	A	Source to Reservoir	Water flowing	Water flowing	Water flowing	Water flowing	Water flowing
Fairfield	IL1910100	IN71500	Little Wabash River	A	Source to Reservoir	Bridge Gage @ 4 ft	Gage 3' 9"(down 3")	4' 2" (up 5")	3' 9"	4' 5"
Fairfield	IL1910100	IN71501	Fairfield Reservoir	A	Main Source - No Concerns	Full	Full	Full	Full	Full
IAWC Cairo	IL0035030	IN70010	Ohio River	A	Main Source - No Concerns	Unchanged	Unchanged	Unchanged	Unchanged	Unchanged
Kinkaid-Reeds Creek Wtr Sys	IL0775100	IN70620	Kinkaid Lake	A	Main Source - No Concerns	Normal Pool 420'	Level 418.9'	Level 418.8'	Level 418.7'	Level 418.5'
Lake of Egypt	IL19952	IN718	Lake of	A	Main Source -	Unchanged	Unchanged	Rise in	No change	Little

PWD	00	40	Egypt		No level Monitor	ed	ed	lake level -rain		Change down
Marion	IL1990550	IN01355	Herrin New Reservoir	A	Inactive	Inactive	Inactive	Inactive	Inactive	Inactive
Marion	IL1990550	IN71850	Marion City Lake	A	Inactive - purchase supply Rend Lake	Inactive	Inactive	Inactive	Inactive	Inactive
Olney	IL1590200	IN71170	East Fork Lake	A	Main Source - No Concerns	7" below pool	No report	13" below pool	14" below pool	16" below pool
Pinckneyville	IL1450150	IN71000	Lake Pinckneyville	A	Main Source - No Concerns	1' 3" below Spillway	1' 6" below pool	1' 7" below pool	2' 0" below pool	2' 2" below pool
Rend Lake Inter-City Water Commsn	IL0555100	IN70290	Rend Lake	A	Main Source - No Concerns	Unchanged (Pool 405')	above pool	above normal pool	above pool (405.51')	above pool (405.3')
Vienna	IL0870350	IN70810	Bloomfield Lake	A	Source to Reservoir	Pool 424' now 420'	Level 419' 8"	419' 4"	419'	421'
Vienna	IL0870350	IN70811	Vienna Reservoir	A	Main Source - No concerns	Keeping Full	Down 8"	Down 10" (now filling)	Down 12" (filling)	Full
Vienna Correctional Center	IL0875510	IN70800	Reservoir	A	Main Source - 2' 3" below spillway	2' 5" below (10' is TOI)	2' 6" below	3' 1" below	3' 4" below	3' 9" below
Wayne City	IL19104	IN715	Skillet	A	Source to	Over	Over	Over	Over	Slightly over

	50	60	Fork		Reservoir	Spillway	Spillway	Spillway	Spillway	Spillway
Wayne City	IL19104 50	IN715 61	Wayne City Reservoir	A	Main Source - No Concerns	Full	Near Full	Full	Full	Full



# Community & Non-Community Surface Water Supply Intakes - PWS Region 7

## COMMUNITY WATER SUPPLY INTAKES

System Name	Sys #	Intake ID
Alto Pass Wtr. Dist	1815150	71330
Alto Pass Wtr. Dist	1815150	71331
Carbondale	0770150	70550
Carbondale	0770150	70551
Fairfield	1910100	01369
Fairfield	1910100	71500
Fairfield	1910100	71501
Kinkaid-Reeds Creek Wtr Sys	0775100	70620
Lake of Egypt PWD	1995200	71840
Olney	1590200	71170
Pinckneyville	1450150	71000
Rend Lake Inter-City Water Commn	0555100	70290
Vienna	0870350	70810
Vienna	0870350	70811
Vienna Correctional Center	0875510	70800
Wayne City	1910450	71561
Wayne City	1910450	71560

## NON-COMMUNITY WATER SUPPLY INTAKES

Sys #	System Name
0034579	EAST FORK CAMPGROUND

## LEGEND

- Community Water Supply Intakes
- Non-Community Intakes
- Interstates
- State Highways
- US Highways
- Rivers and Streams
- PWS Region 7
- County Boundaries

## Contacts

**Division of Public Water Supplies:**  
 Marion Regional Office - 618/993-7200  
 Jon Lam  
 Field Operation Headquarters - Springfield  
 217/782-1020  
 Dave McMillan - Manager

**Division of Water Pollution Control:**  
 Marion Region - 618/993-7200  
 Byron Marks - Manager  
 Headquarters - Springfield - 217/782-3362  
 Bruce Yurdin - FOS Manager


**Illinois Department of Public Health:**  
 217/782-5830  
 Division of Environmental Health  
 Ken Runkle - Chief  
 Non-Community Public Water System Program  
 Eric Portz - Manager



Division of Public Water Supplies  
 Groundwater Section  
 January, 2011



10 0 10 20 30 40 50 Miles

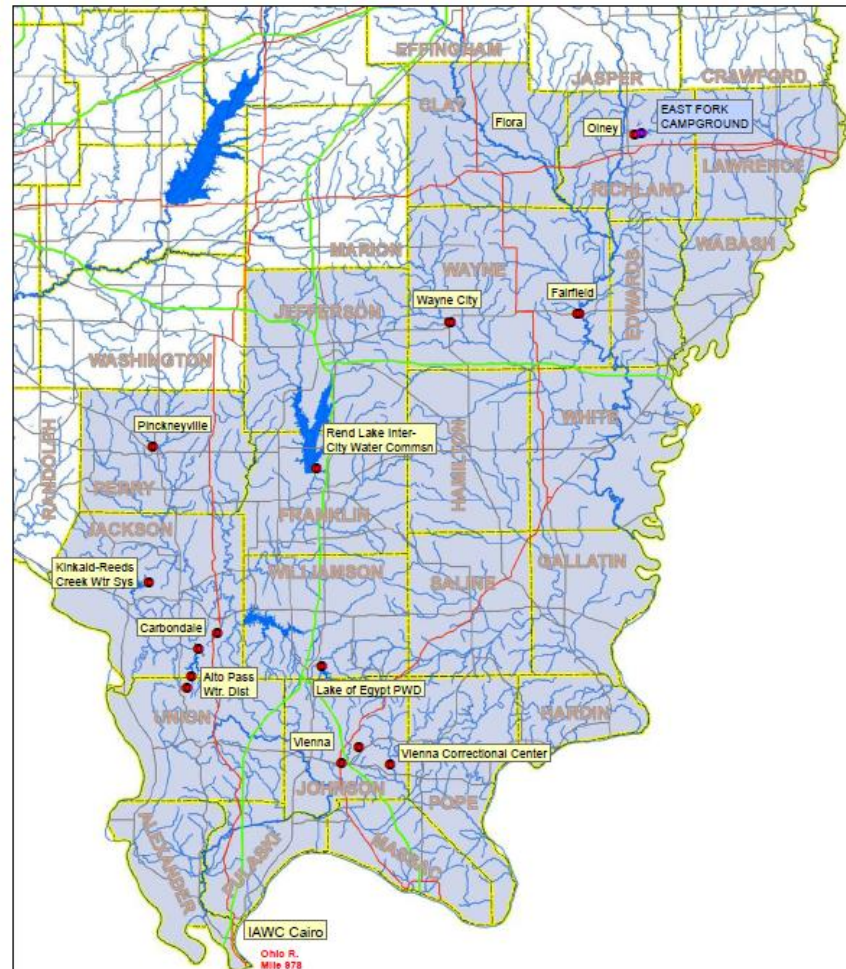

## Region 7 Surface Water System Contacts

System	Sys. #	Name & Certification	Business	Emergency
ALTO PASS WATER DISTRICT	IL1815150	WILMOUTH, SCOTT	DO	618-687-2951
ALTO PASS WATER DISTRICT	IL1815150	WILMOUTH, SCOTT	AC	618-893-4332 618-534-7938
CARBONDALE	IL0770150	COLE, KIMBERLY A.	DO	618-457-3240
CARBONDALE	IL0770150	JONES, DALE E.	DO	618-457-3240
CARBONDALE	IL0770150	HARRISON, ANTHONY R.	DO	618-457-3240
CARBONDALE	IL0770150	PONCE, BETH A.	AC	618-457-3270
FAIRFIELD	IL1910100	BOYD, DAVID	DO	618-847-4241 618-842-4821
FAIRFIELD	IL1910100	ZURLIENE, DENNIS	DO	618-842-7015 618-842-3241
FAIRFIELD	IL1910100	BORAH, WAYNE M.	AC	618-842-3871 618-842-4821
FLORA	IL0250100	HEADLEE, BRENT	DO	618-662-8678
FLORA	IL0250100	PAYNE, RODNEY	DO	618-662-6705 618-662-6705
FLORA	IL0250100	RINEHART, TOBY	AC	618-662-4825
IL AMERICAN-CAIRO	IL0035030	KEITH, STEPHEN	DO	618-734-3808
IL AMERICAN-CAIRO	IL0035030	DUNDORE, ESTHER	DO	618-239-3249 800-422-2782
IL AMERICAN-CAIRO	IL0035030	DUNDORE, ESTHER	AC	618-239-3249 800-422-2782
KINKAID AREA WATER SYSTEM	IL0775100	YAMAMOTO, KEN	DO	618-687-2951 618-687-1722
KINKAID AREA WATER SYSTEM	IL0775100	GUTHMAN, RYAN	AC	618-687-1722
LAKE OF EGYPT PWD	IL1995200	GURLEY, CLIFTON J.	DO	618-964-1380
LAKE OF EGYPT PWD	IL1995200	RIX, RYAN W.	DO	618-965-1380
LAKE OF EGYPT PWD	IL1995200	RHODES, GARY	DO	618-893-2322
LAKE OF EGYPT PWD	IL1995200	RHODES, GARY	AC	618-964-1380
OLNEY	IL1590200	UMFLEET, THOMAS	DO	618-392-3741 618-843-8492
OLNEY	IL1590200	BRADLEY, FRANK	DO	618-392-3741 618-843-8492
OLNEY	IL1590200	BUKAS, RANDY	AC	618-395-7302
PINCKNEYVILLE	IL1450150	AHNER, GARY W.	DO	618-357-5214
PINCKNEYVILLE	IL1450150	MILLIKIN, MICHAEL	DO	618-357-6002
PINCKNEYVILLE	IL1450150	MILLIKIN, MICHAEL	AC	618-357-6002
REND LAKE INTER-CITY WATER SYSTEM	IL0555100	KILLMAN, LEONARD L.	DO	618-439-4394
REND LAKE INTER-CITY WATER SYSTEM	IL0555100	THOMASON, KEITH	AC	618-439-4321 618-439-4394
VIENNA	IL0870350	LEGGETT, DALE R.	DO	618-658-3821
VIENNA	IL0870350	HOSFELDT, HERBERT R.	DO	618-658-3821
VIENNA	IL0870350	SIMMONS, JON A.	AC	618-658-5161
VIENNA CORRECTIONAL CTR	IL0875510	MAZE, DALLAS	DO	618-995-2952 618-995-2961
VIENNA CORRECTIONAL CTR	IL0875510	DILLMAN, MARK	AC	618-658-8371 618-658-8371
WAYNE CITY	IL1910450	NOE, ROGER	DO	618-895-2166 618-895-4858
WAYNE CITY	IL1910450	DESCH, SHAWNTELL	AC	618-895-2241 618-919-0540

"DO" = Designated Operator

"AC" = Administrative Contact



